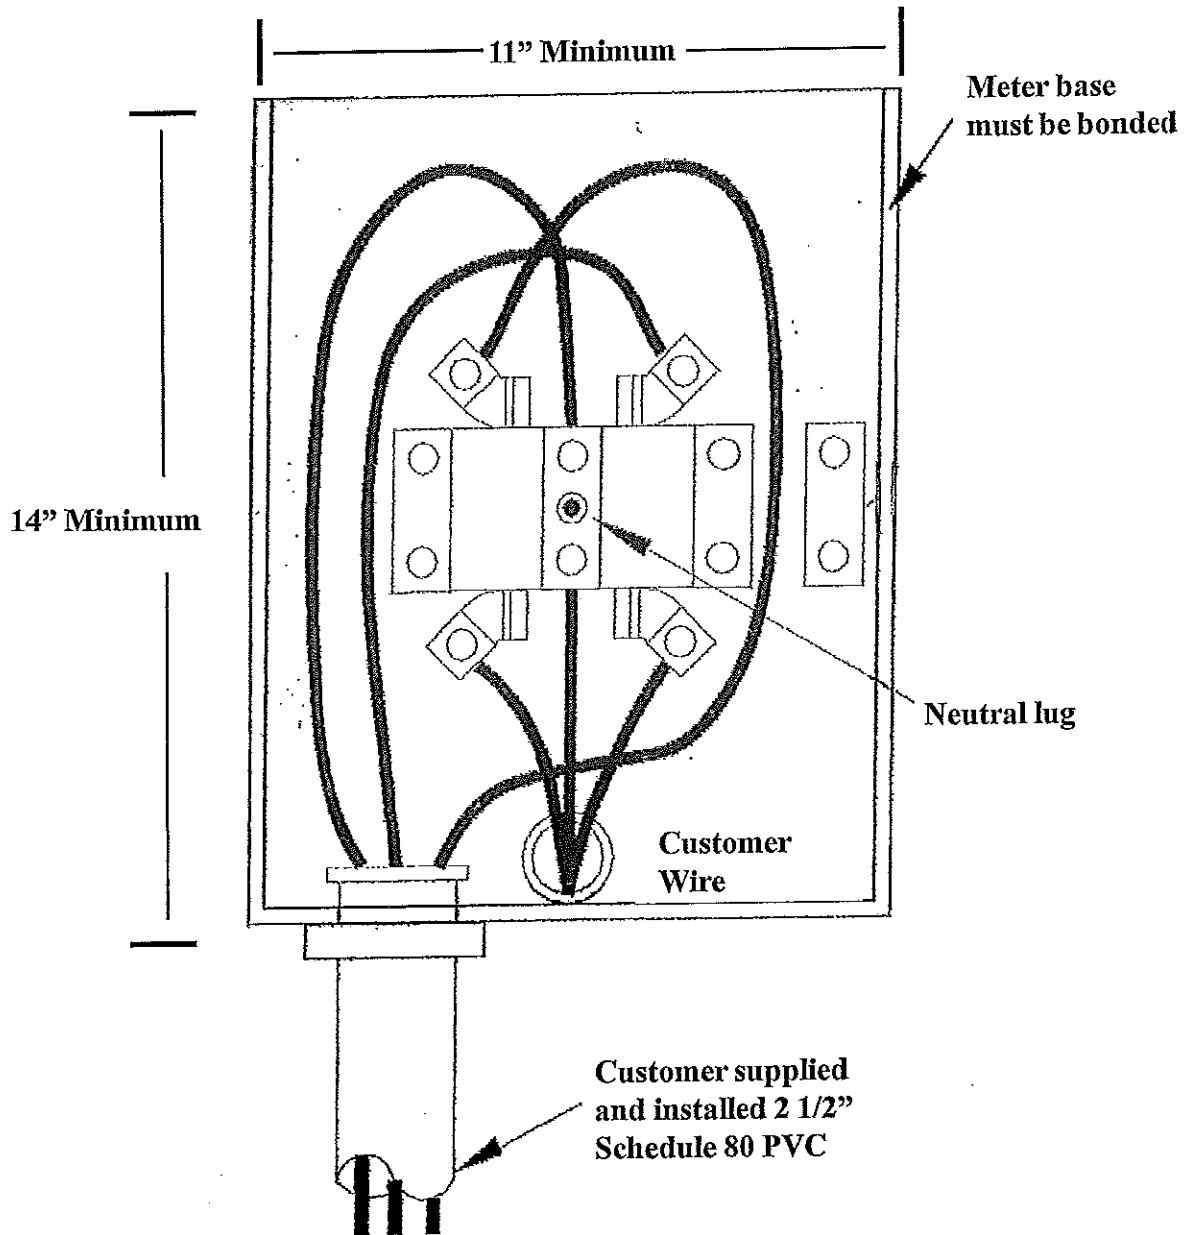


**Noble REMC requires that all new 100 and 200 amp underground single phase services use this configuration of meter enclosure.  
Noble REMC will not connect to meter enclosures that do not meet this specification.**



**Figure D-2  
200 Amp underground meter base**